

THE PORT AUTHORITY
OF NY & NJ

CONFORMED DRAWING
09/2/86
STAMPED AND SEALED
COPY IS KEPT ON FILE

ORIGINAL SIGNED & SEALED BY
N.Y. P.E. (OR R.A.)

Joseph R. Loring
& Associates, Inc.
consulting engineers

One Pennsylvania Plaza
New York, New York 10009-0043
Tel (212) 363-7400, Fax (212) 363-7382

THE OFFICE OF
DAVID
ELLIOT
LEBOVITZ
P.C.
CONSULTING ENGINEERS
100 WALL STREET
NEW YORK, N.Y. 10005
TEL. (212) 363-7400 FAX (212) 363-7382

LESLIE E ROBERTSON
ASSOCIATES, R.L.P.
CONSULTING ENGINEERS
100 WALL STREET
NEW YORK, N.Y. 10005
TEL. (212) 363-7400 FAX (212) 363-7382

No Date Revision Approved
Engineering Department
Design Division

The
World
Trade
Center




STANDBY POWER
5 WORLD TRADE CENTER

ELECTRICAL


5 WTC PART PLANS
CONDUIT RISER SHAFTS
& DETAILS SHEET 1

This drawing is subject to conditions in contract
to which it is attached. No part of this drawing
shall be used without the written consent
of the Port Authority.


Designed by: MAB
Drawn by: [blank]
Checked by: [blank]
Date: 11/17/87
Scale: AS NOTED
Contract Number: WTC-045.071
Drawing Number: E4-02

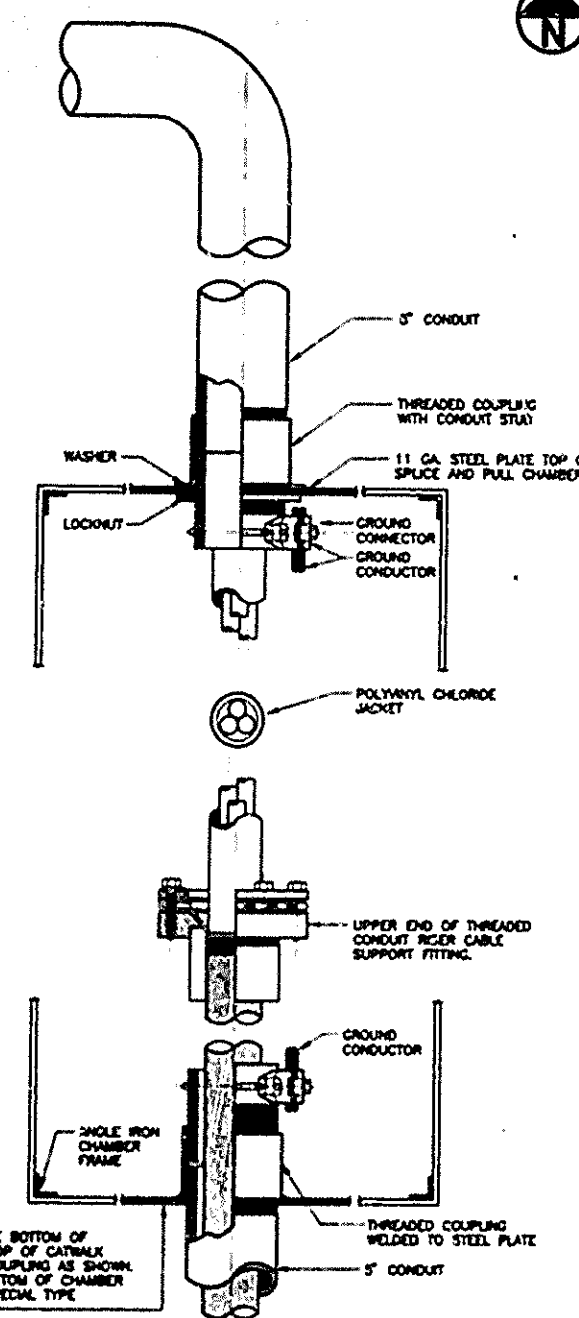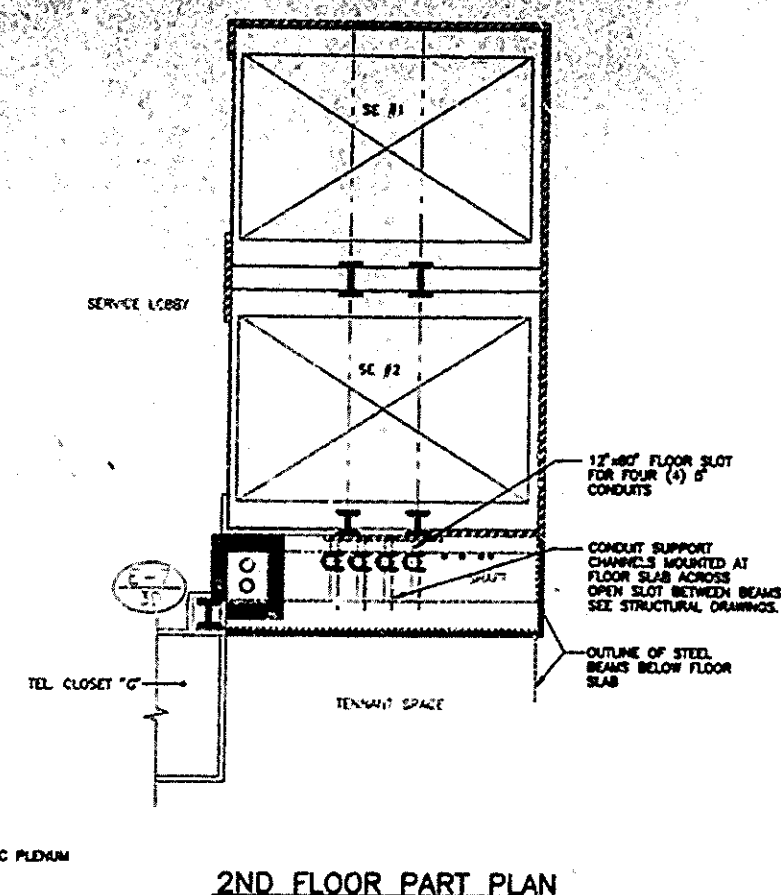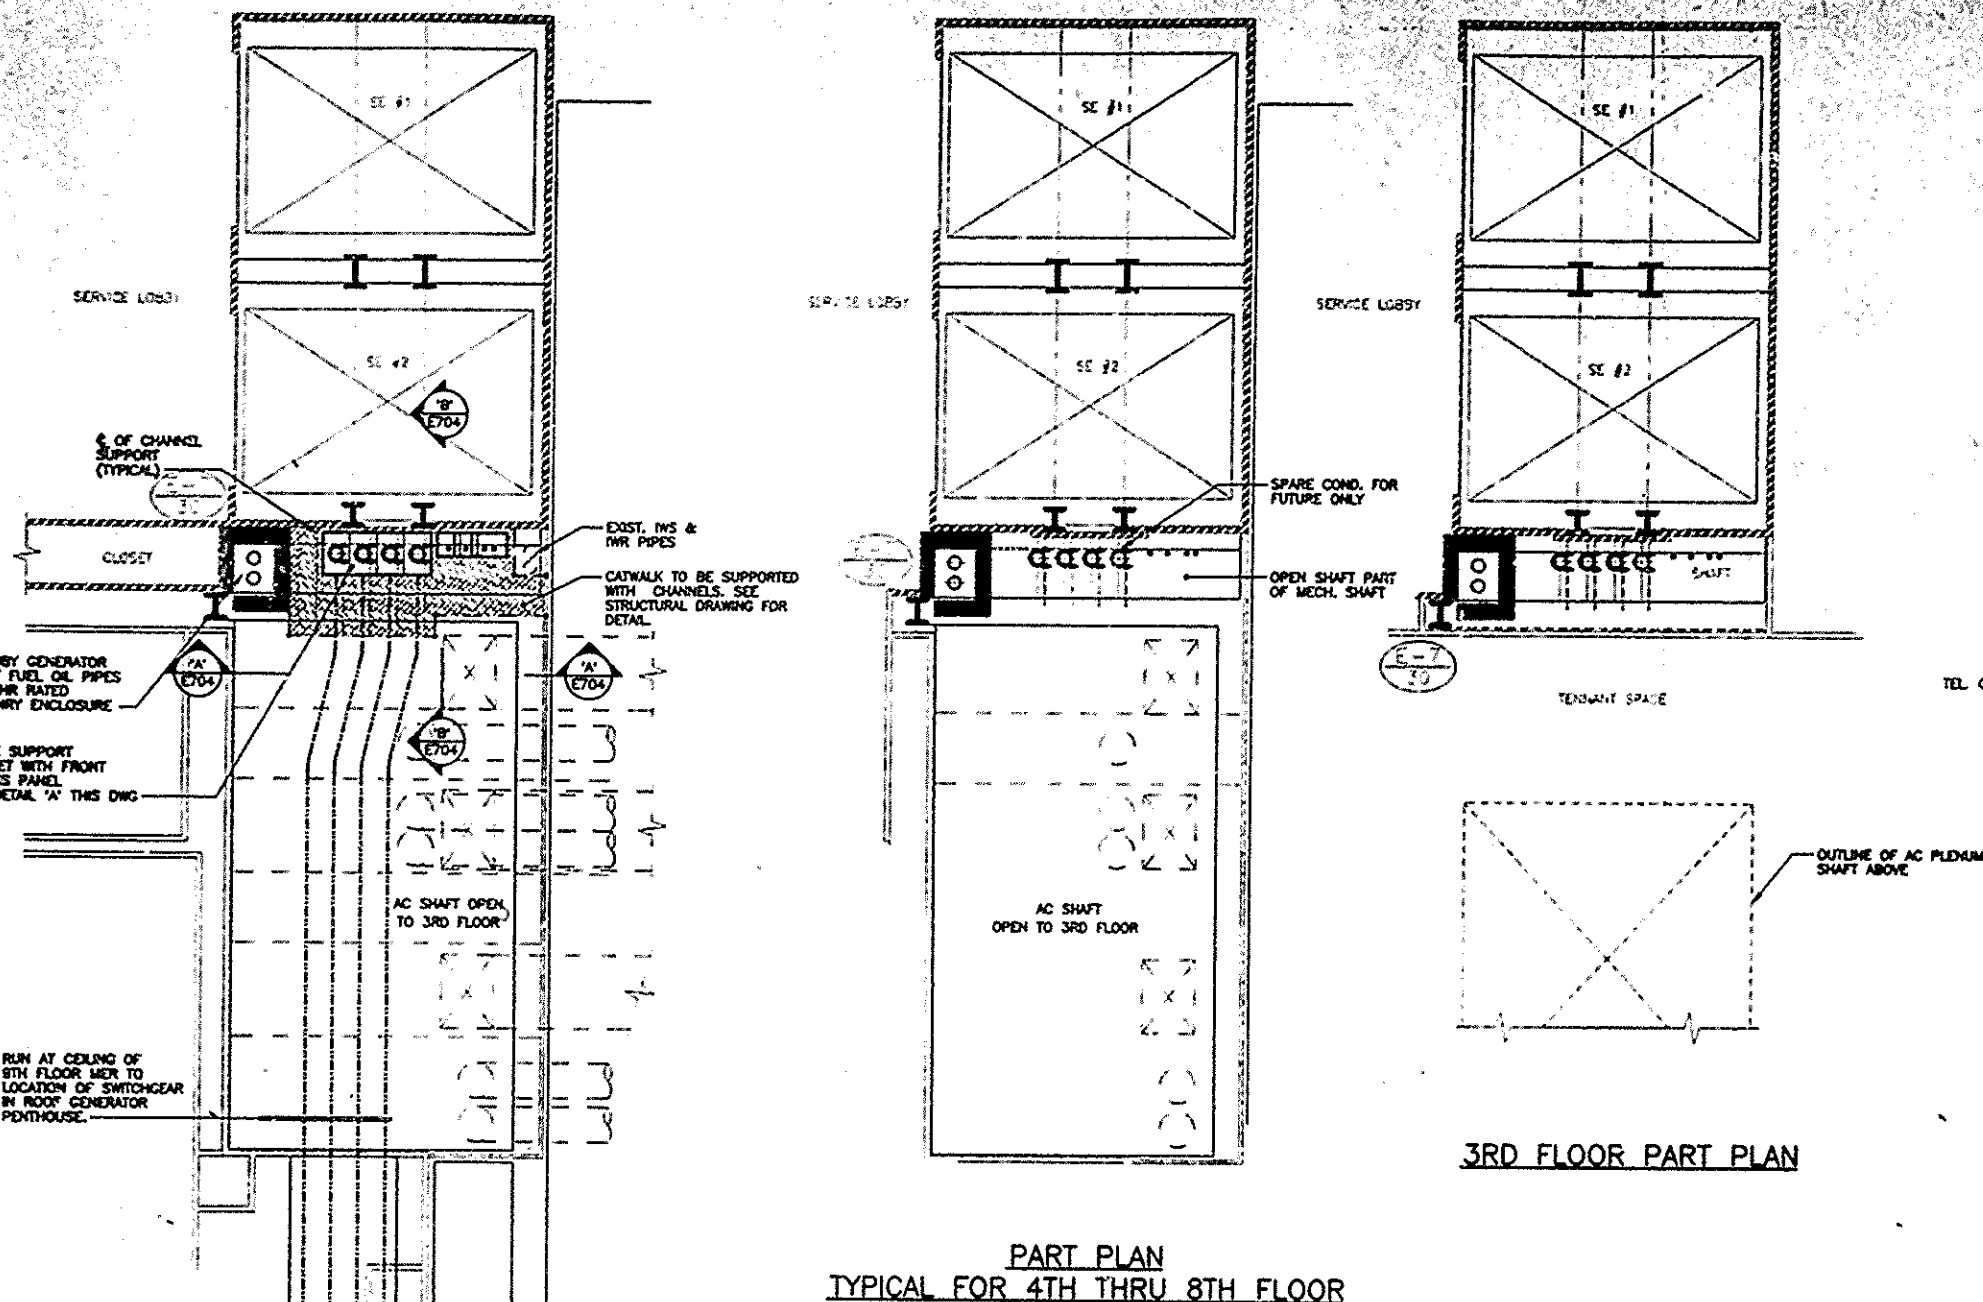

TYPICAL INSTALLATION DETAIL OF
15 KV ARMORED CABLE SUPPORTS
IN SPLICE AND PULL CABINET
NOT TO SCALE


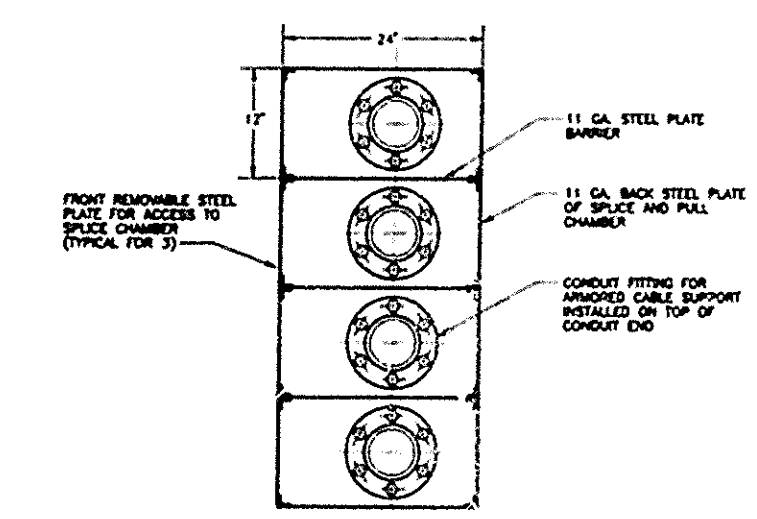


DETAIL "A"
HORIZONTAL SECTION THRU
CABLE PULL & SPLICE CABINET
AT CABLE SUPPORT FITTINGS
NOT TO SCALE

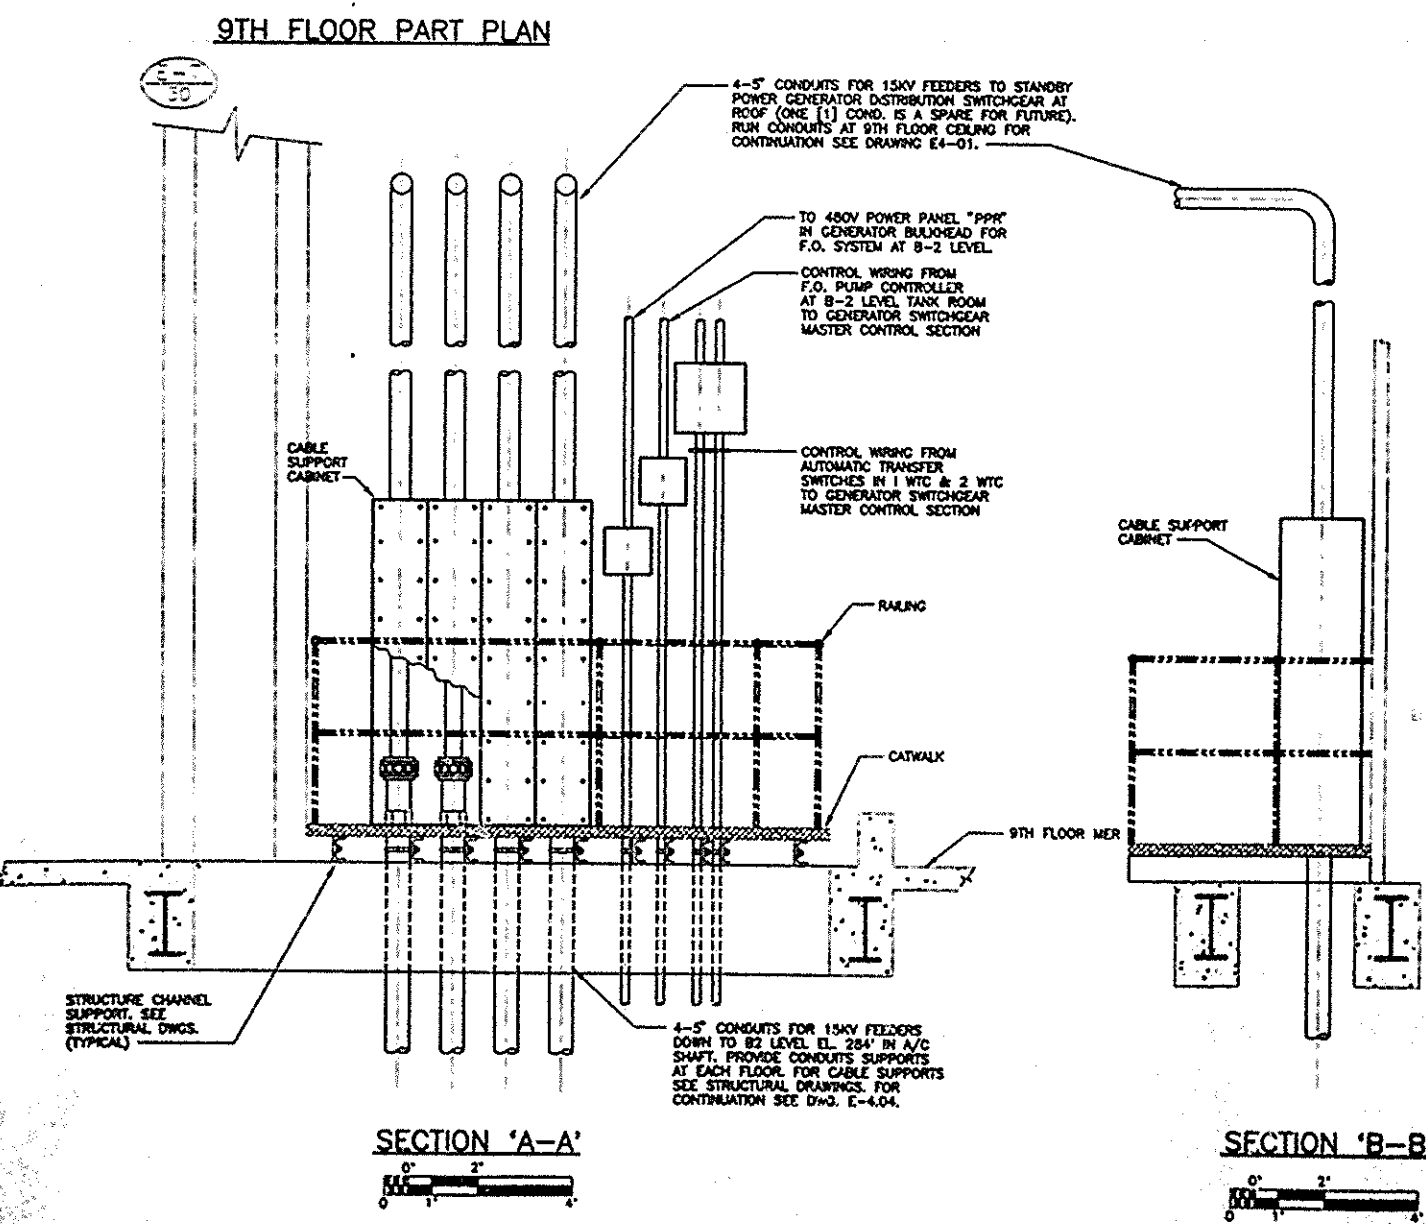

SECTION 'A-A'
0' 1' 2'

SECTION 'B-B'
0' 1' 2'

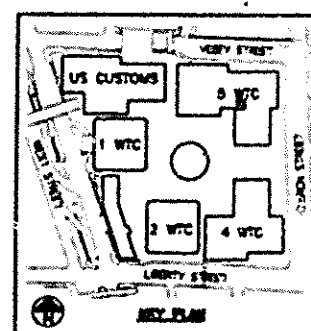

SEE PLAN